

-#2/0 STRANDED BARE COPPER CONDUCTOR

-CLAMP OR COPPERWELD CONNECTION TYPICAL FOR ALL REQUIRED CONNECTIONS

-3/4" DIA. x 10'-0"L COPPERCLAD

(TYP. OF 2, 10'-0" APART)

GROUND ELECTRODE.

TO FOUNDATION FOOTER STEEL, WATER

, PIPING, & SWITCHGEAR.

3'-0" A.F.F.


<u>TELEPHONE GROUND BAR</u>

FOOTER STEEL GROUND ELECTRODE DETAIL

INSTALLATION TO BE LOCATED AT BUILDING ELECTRICAL SERVICE ENTRANCE.

FOUNDATION FOOTER STEEL:

FOUNDATION FOOTER-

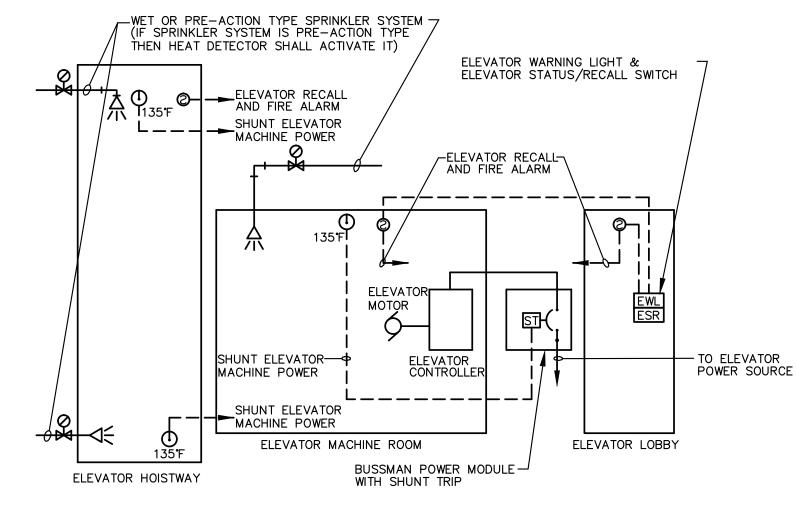

ELEVATOR FIRE CONTROL & ALARM DETAIL N.T.S.





■ DUPLEX RECEPTACLE

Interiors, & Sustainable Design AA26001584 185 NE 4TH AVENUE SUITE 101 DELRAY BEACH, FL 33483

T: (561) 276-4951 F: (561) 243-8184 E-MAIL: office@csa-architects.com

10-13-14

ISSUED FOR:

PERMIT 04-09-2015

CONSTRUCTION

SEAL NO. 51758 STATE OF

PROJECT TITLE CITY OF HALLANDALE BEACH FIRE RESCUE STATION

111 FOSTER ROAD HALLANDALE BEACH, FL

	33009		
	REVISIONS		
	NUM.	DESCRIPTION	DATE
	1	BUILDING DEPT. COMMENTS	05/15/15
	3	BLDG DEPT. COMM./ COORDINATION	07/10/15
	5	ADDENDUM	09/14/15

THIS PROJECT HAS BOOK SPECIFICATIONS THAT ARE AN INTEGRAL AND COMPLIMENTARY PART OF THE OF THE CONSTRUCTION

DOCUMENTS.

THESE DRAWINGS ARE PREPARED PER ESTABLISHED INDUSTRY STANDARDS AND REPRESENT THE ARCHITECT AND ENGINEERS DESIGN CONCEPT. THEY ARE NOT INTENDED TO PROVIDE EVERY DETAIL OR CONDITION REQUIRED TO CONSTRUCT THE BUILDING. THE CONTRACTOR THROUGH SUBMITTALS AND OTHER COORDINATION EFFORTS IS FULLY RESPONSIBLE FOR PROVIDING A COMPLETE AND OPERATIONAL BUILDING WHETHER INDICATED ON THE PLANS OR NOT.

FILE NUMBER 14069 E-7.5.DWG

DRAWING TITLE **ELECTRICAL** 

DRAWN BY 01/14/2015 | MB,DJM,AD JOB NUMBER 140403/14069

DRAWING NUMBER